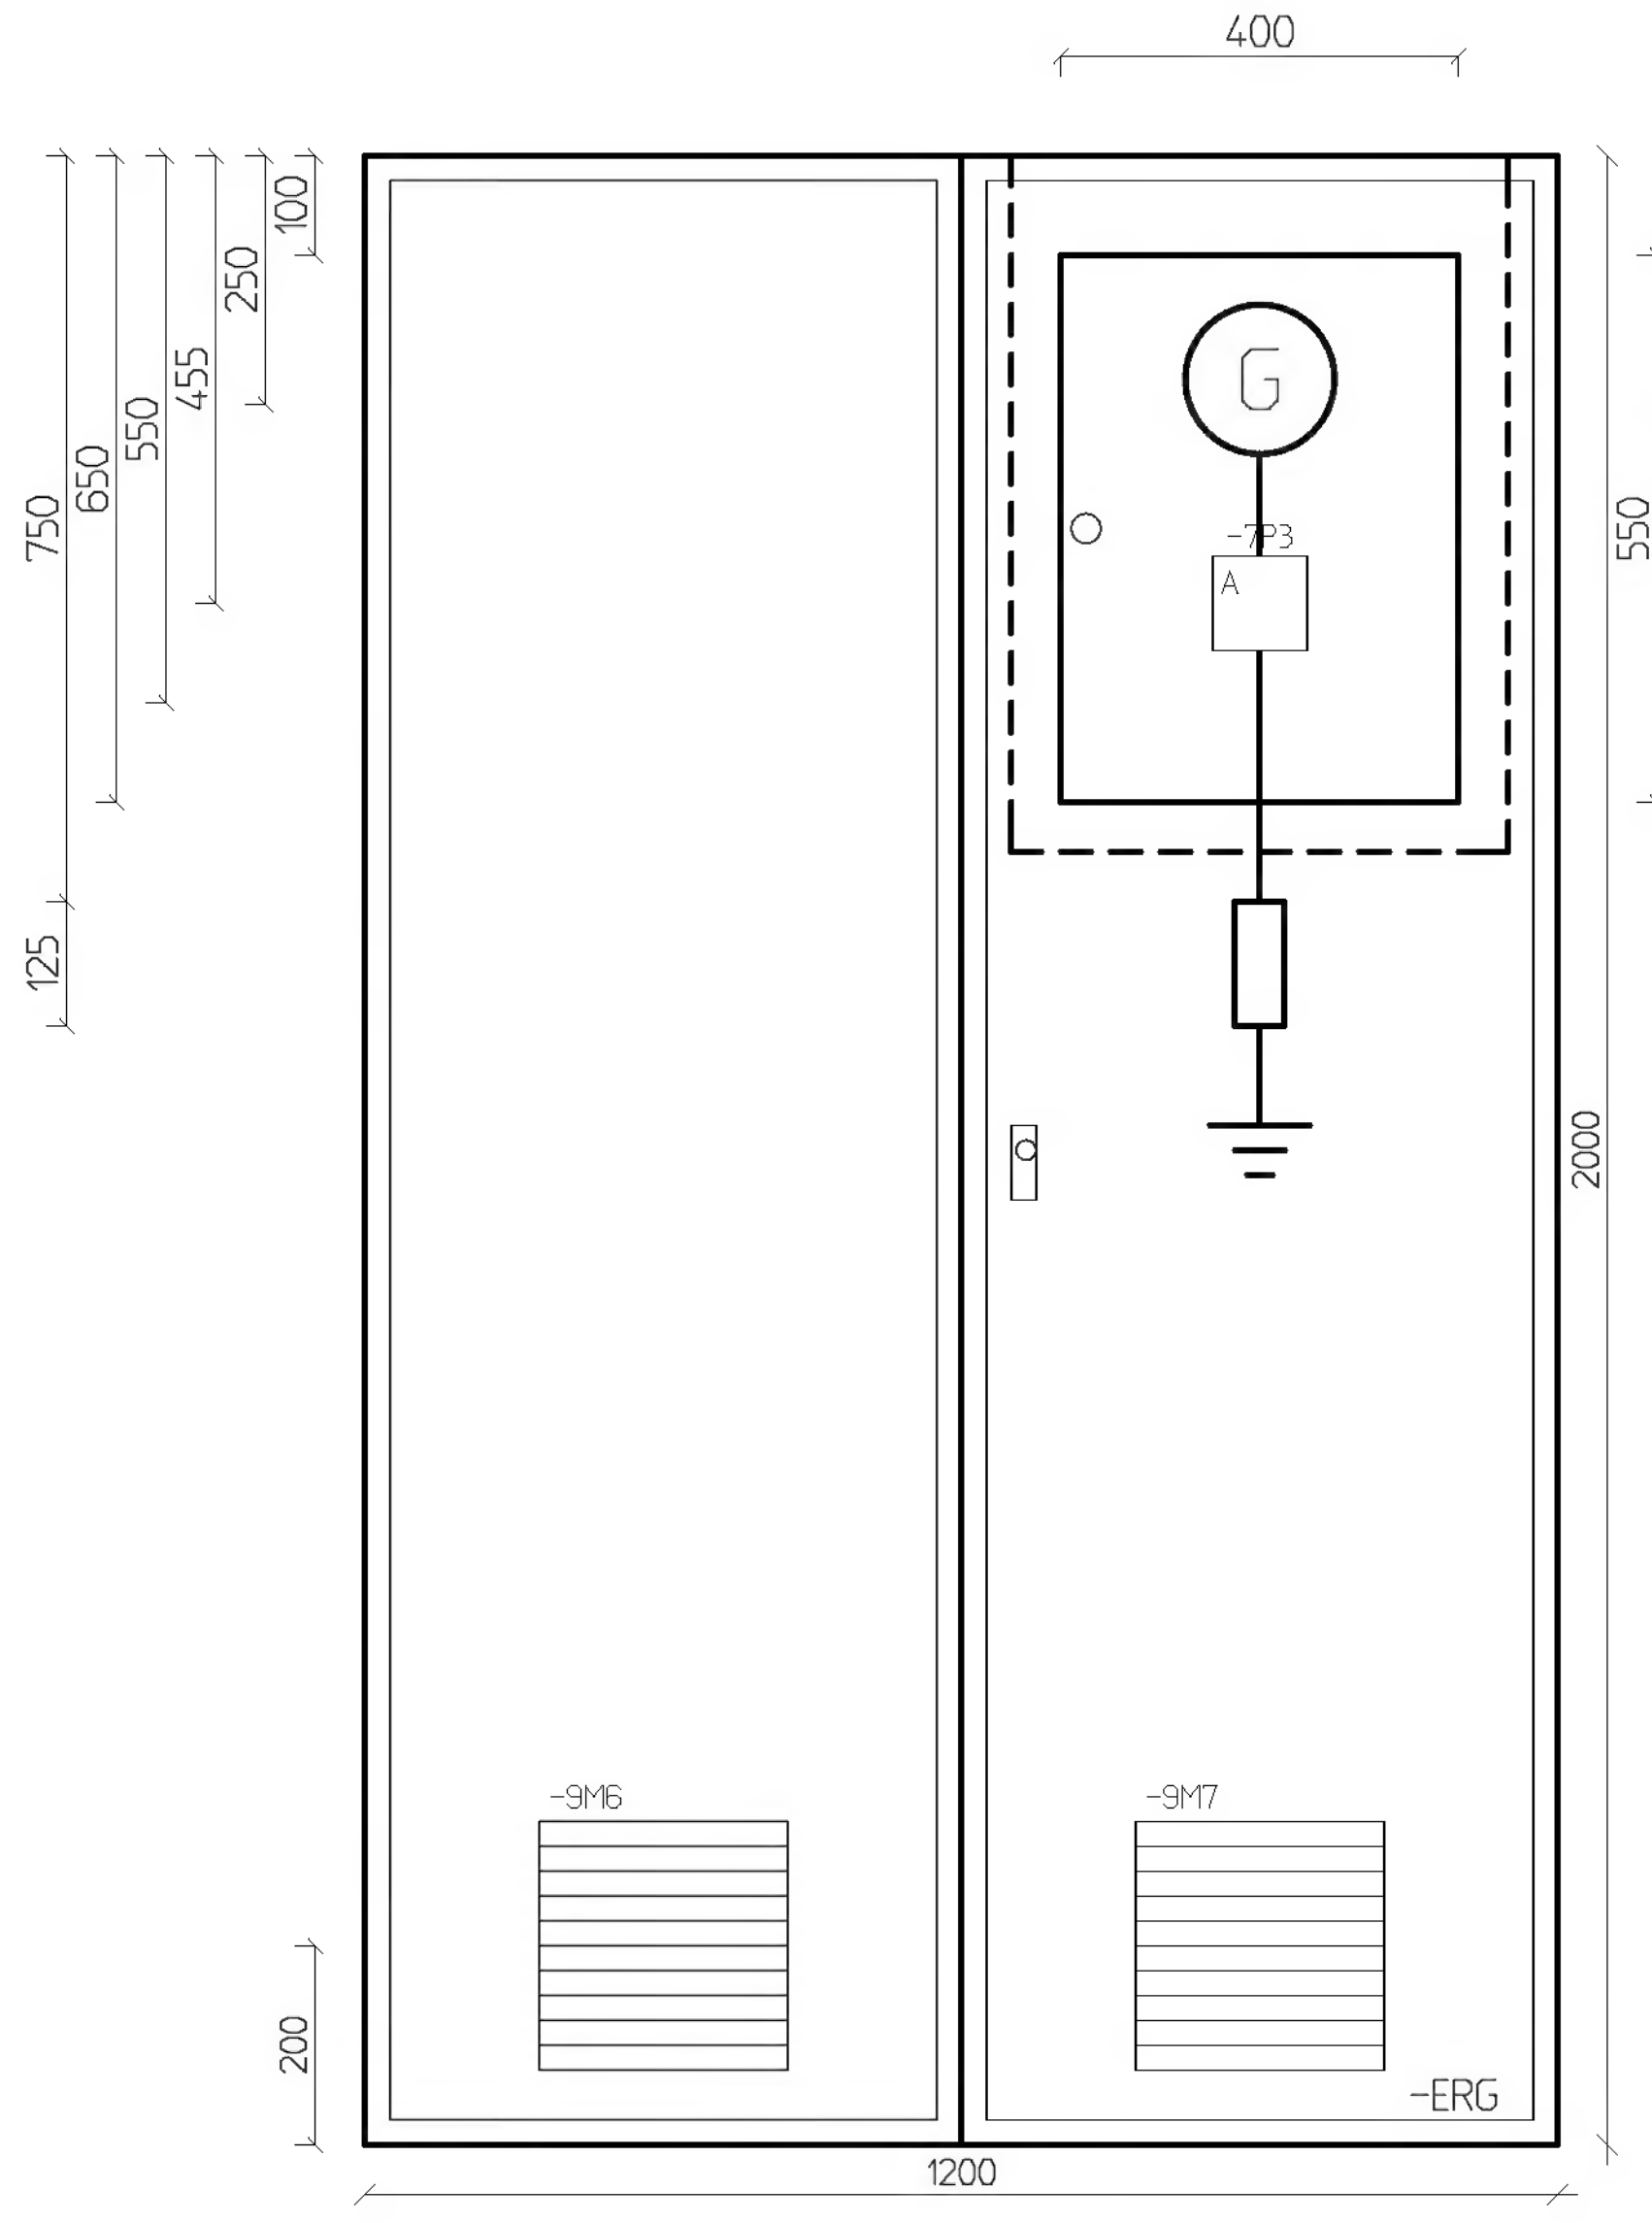

legend

-7P3 Earth fault current (92x92)

control cab	:	TS 8208.600
Cover	:	permanent mounting
Color	:	RAL 7032
Cable gland	:	bottom
Prot type	:	IP 41
Standard	:	EN 60 439 Part 1: 1994
Depth	:	800

All rights reserved by KUHSE for this technical documents

Bildbeschreibung IMAGE DESCRIPTION panel view

			Date	08.07.03	Elektrim-MEGADEX Monde Energy Philippines	KUHSE	DPP 5(7) Syn. MST 5"/10"PC Neutr. Earthing Panel Cummins gen	4500005501	=DPP +ERG1
			Desig.	A. Stellmann				43730	437300
			Check	A. Stellmann					page 1
Index changing	Date	name	Norm	33	Orig. / Ers.f.	Ers.d. 11.09.03			9 BL

side view

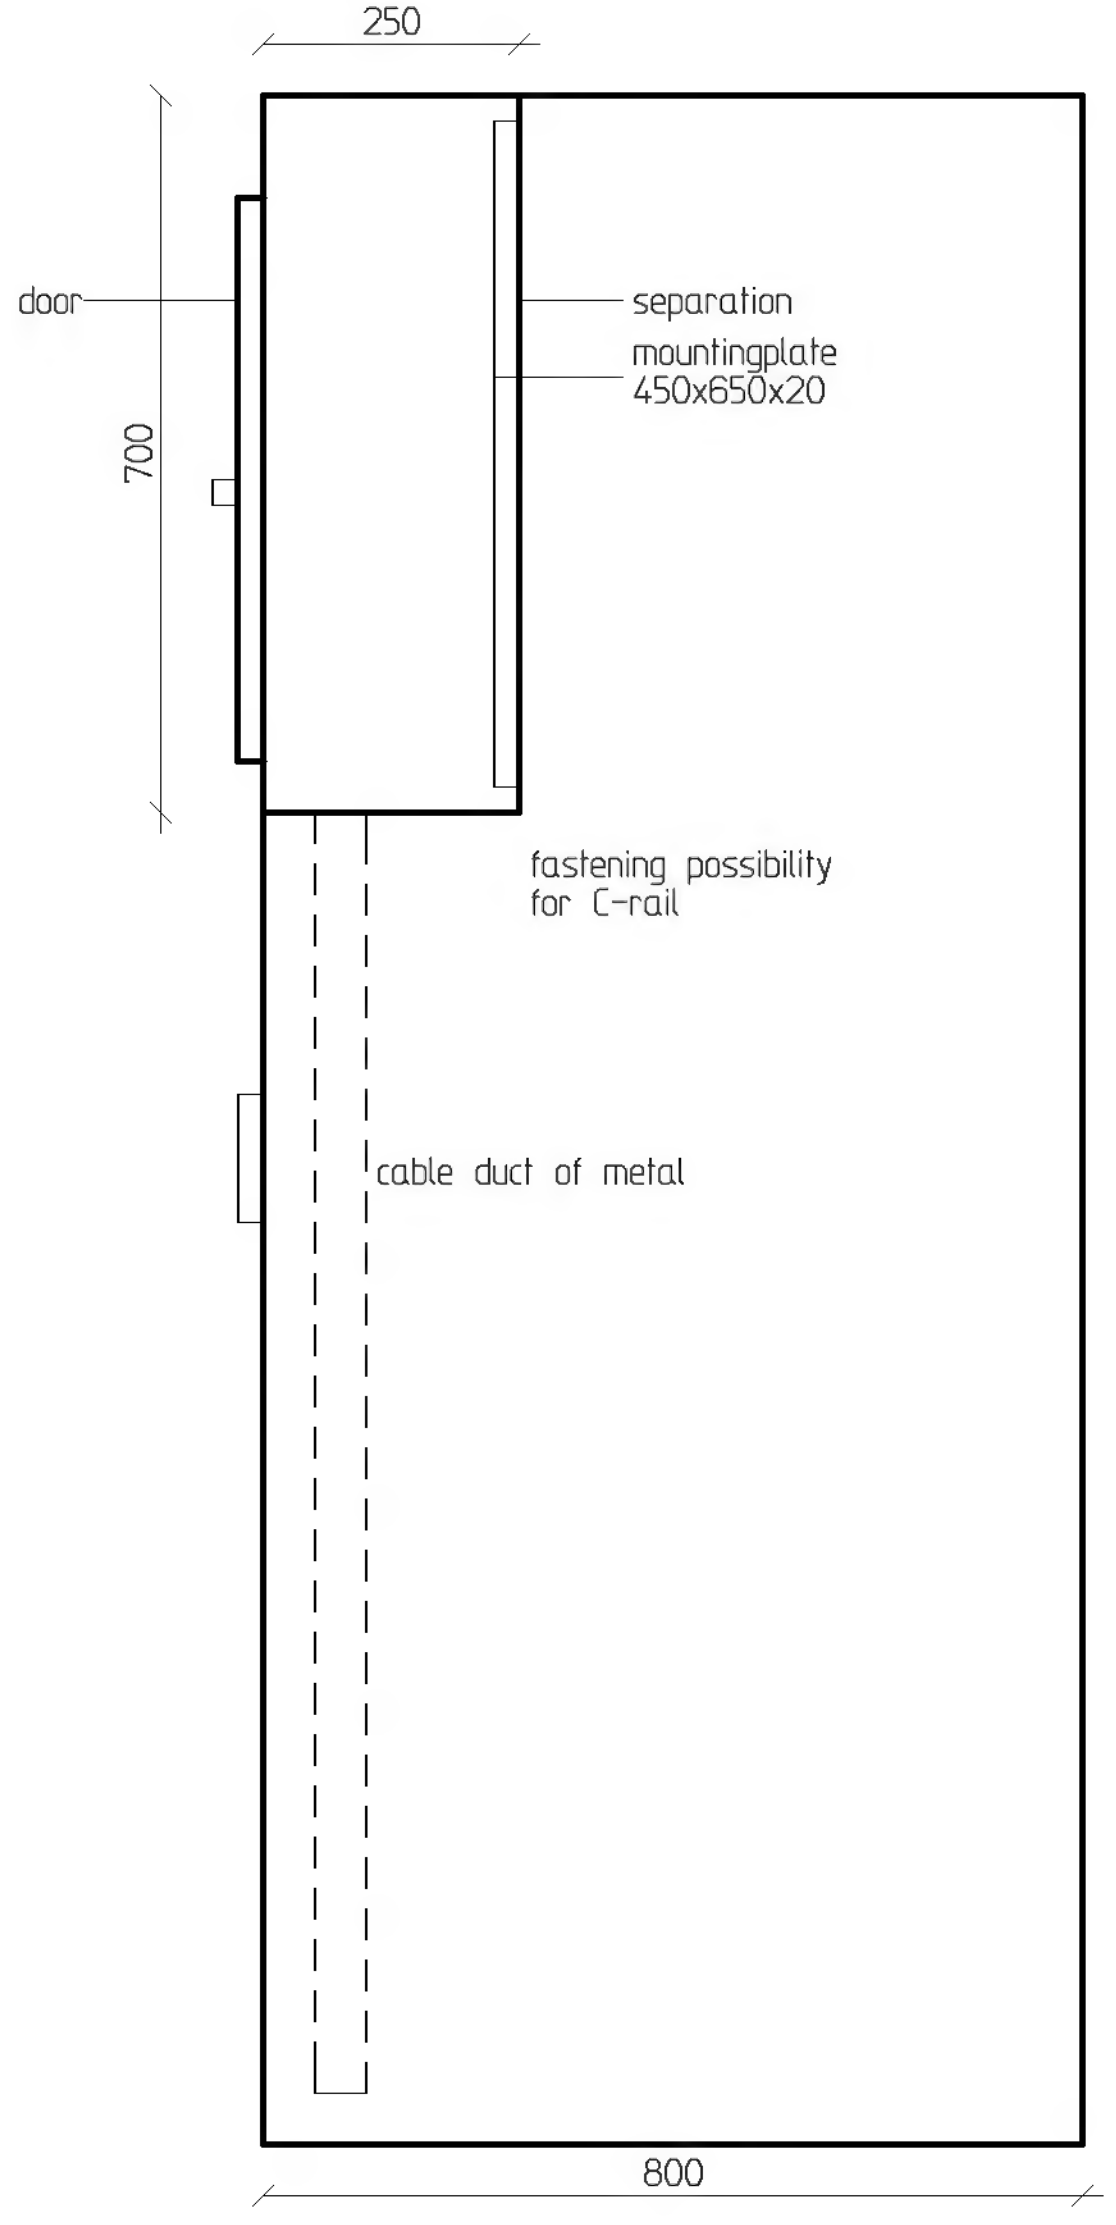

top view partition

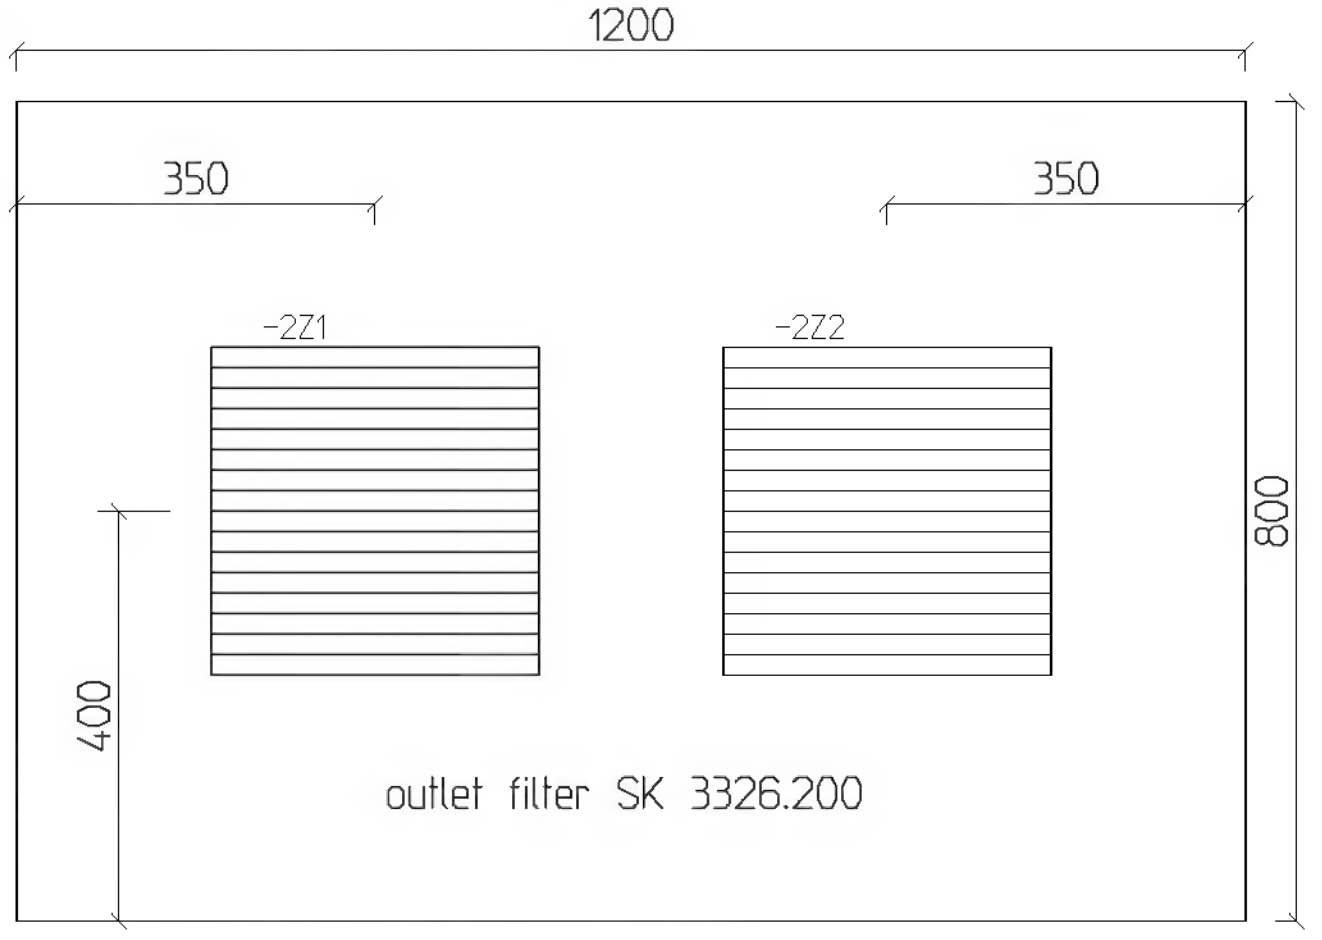

upper view separation

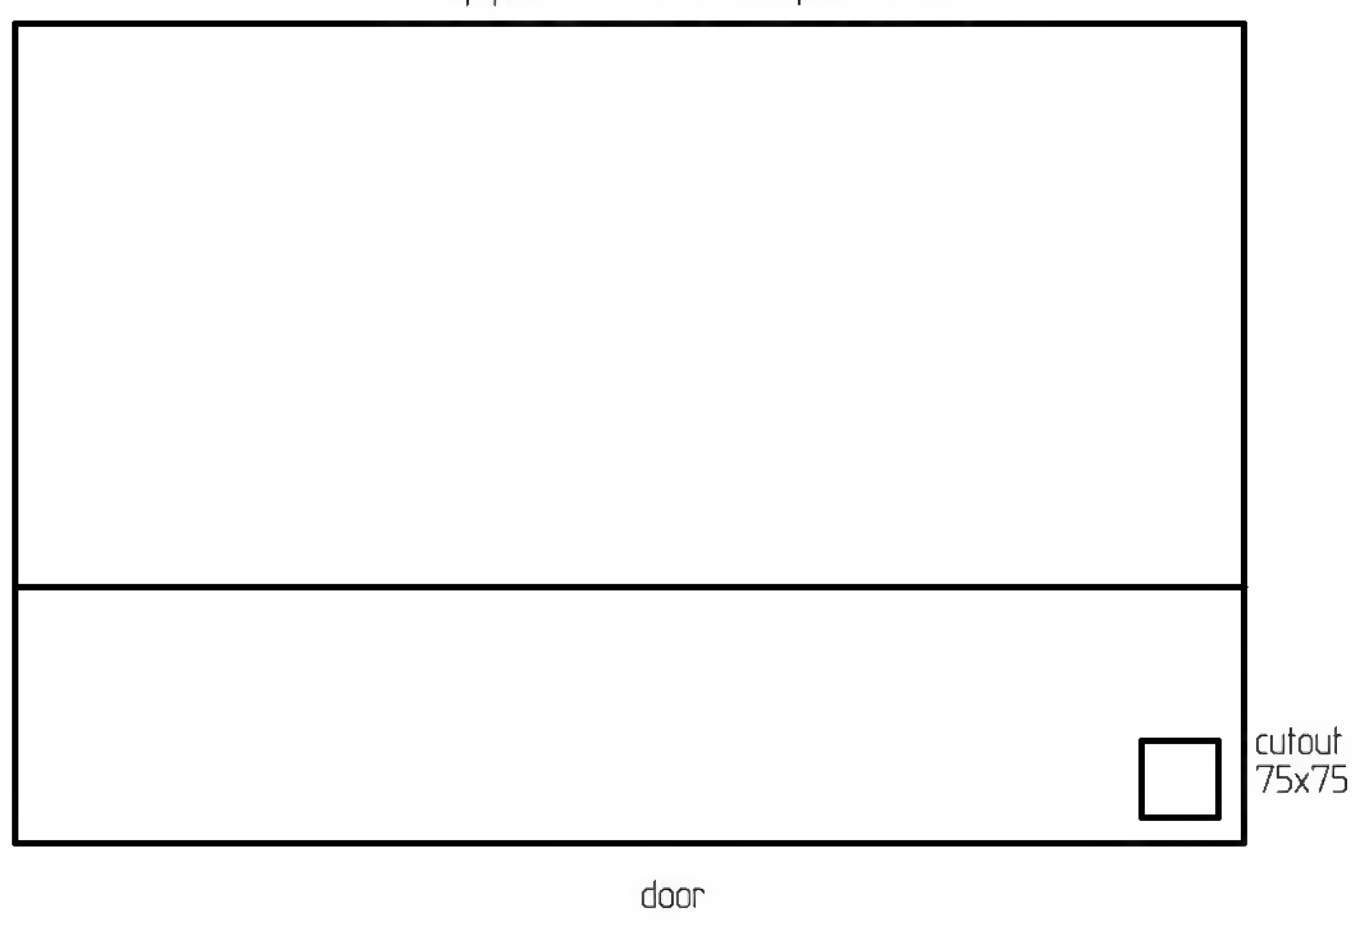

-1Z1
cable inserting sheet 8

-1Z2
Cable gland Ø47

-1Z3
Cable gland Ø47

-1Z4
Cable gland Ø47

-1Z5
Cable gland Ø47

-1Z6
Cable gland Ø47

-1Z7
Cable gland Ø47

All rights reserved by KUHSE
for this technical documents

Bildbeschreibung
IMAGE DESCRIPTION
panel view

				Date	08.07.03	Elektrim-MEGADEX Monde Energy Philippines	KUHSE	DPP 5(7) Syn. MST 5"/10"PC Neutr. Earthing Panel Cummins gen
				Desig.	A. Stellmann			
				Check	A. Stellmann			
Index	changing	Date	name	Norm	33	Orig. / Ers.f.	Ers.d. 11.09.03	

4500005501
43730
437300
=DPP
+ERG1

All rights reserved by KUHSE
for this technical documents

Bildbeschreibung
IMAGE DESCRIPTION

incoming 24 V DC

				Date	08.07.03
				Desig.	A. Stellmann
				Check	A. Stellmann
Index	changing	Date	name	Norm	33

Elektrim-MEGADEX
Monde Energy Philippines

Orig. | Ers.f. | Ers.d. 11.09.03

KUHSE

DPP 5(7) Syn.
MST 5"/10"PC
Neutr. Earthing Panel Cummins gen

4500005501

43730 | 437300

=DPP
+ERG1

page 3
9 BL

All rights reserved by KUHSE
for this technical documents

Bildbeschreibung
IMAGE DESCRIPTION
24V supply, feeders

			Date	08.07.03	Elektrim-MEGADEX Monde Energy Philippines	KUHSE	DPP 5(7) Syn. MST 5"/10"PC Neutr. Earthing Panel Cummins gen	4500005501	=DPP +ERG1
			Desig.	A. Stellmann					
			Check	A. Stellmann				43730 / 437300	page 4
Index	changing	Date	name	Norm 33	Orig. / Ers.f.	Ers.d. 11.09.03			9 BL

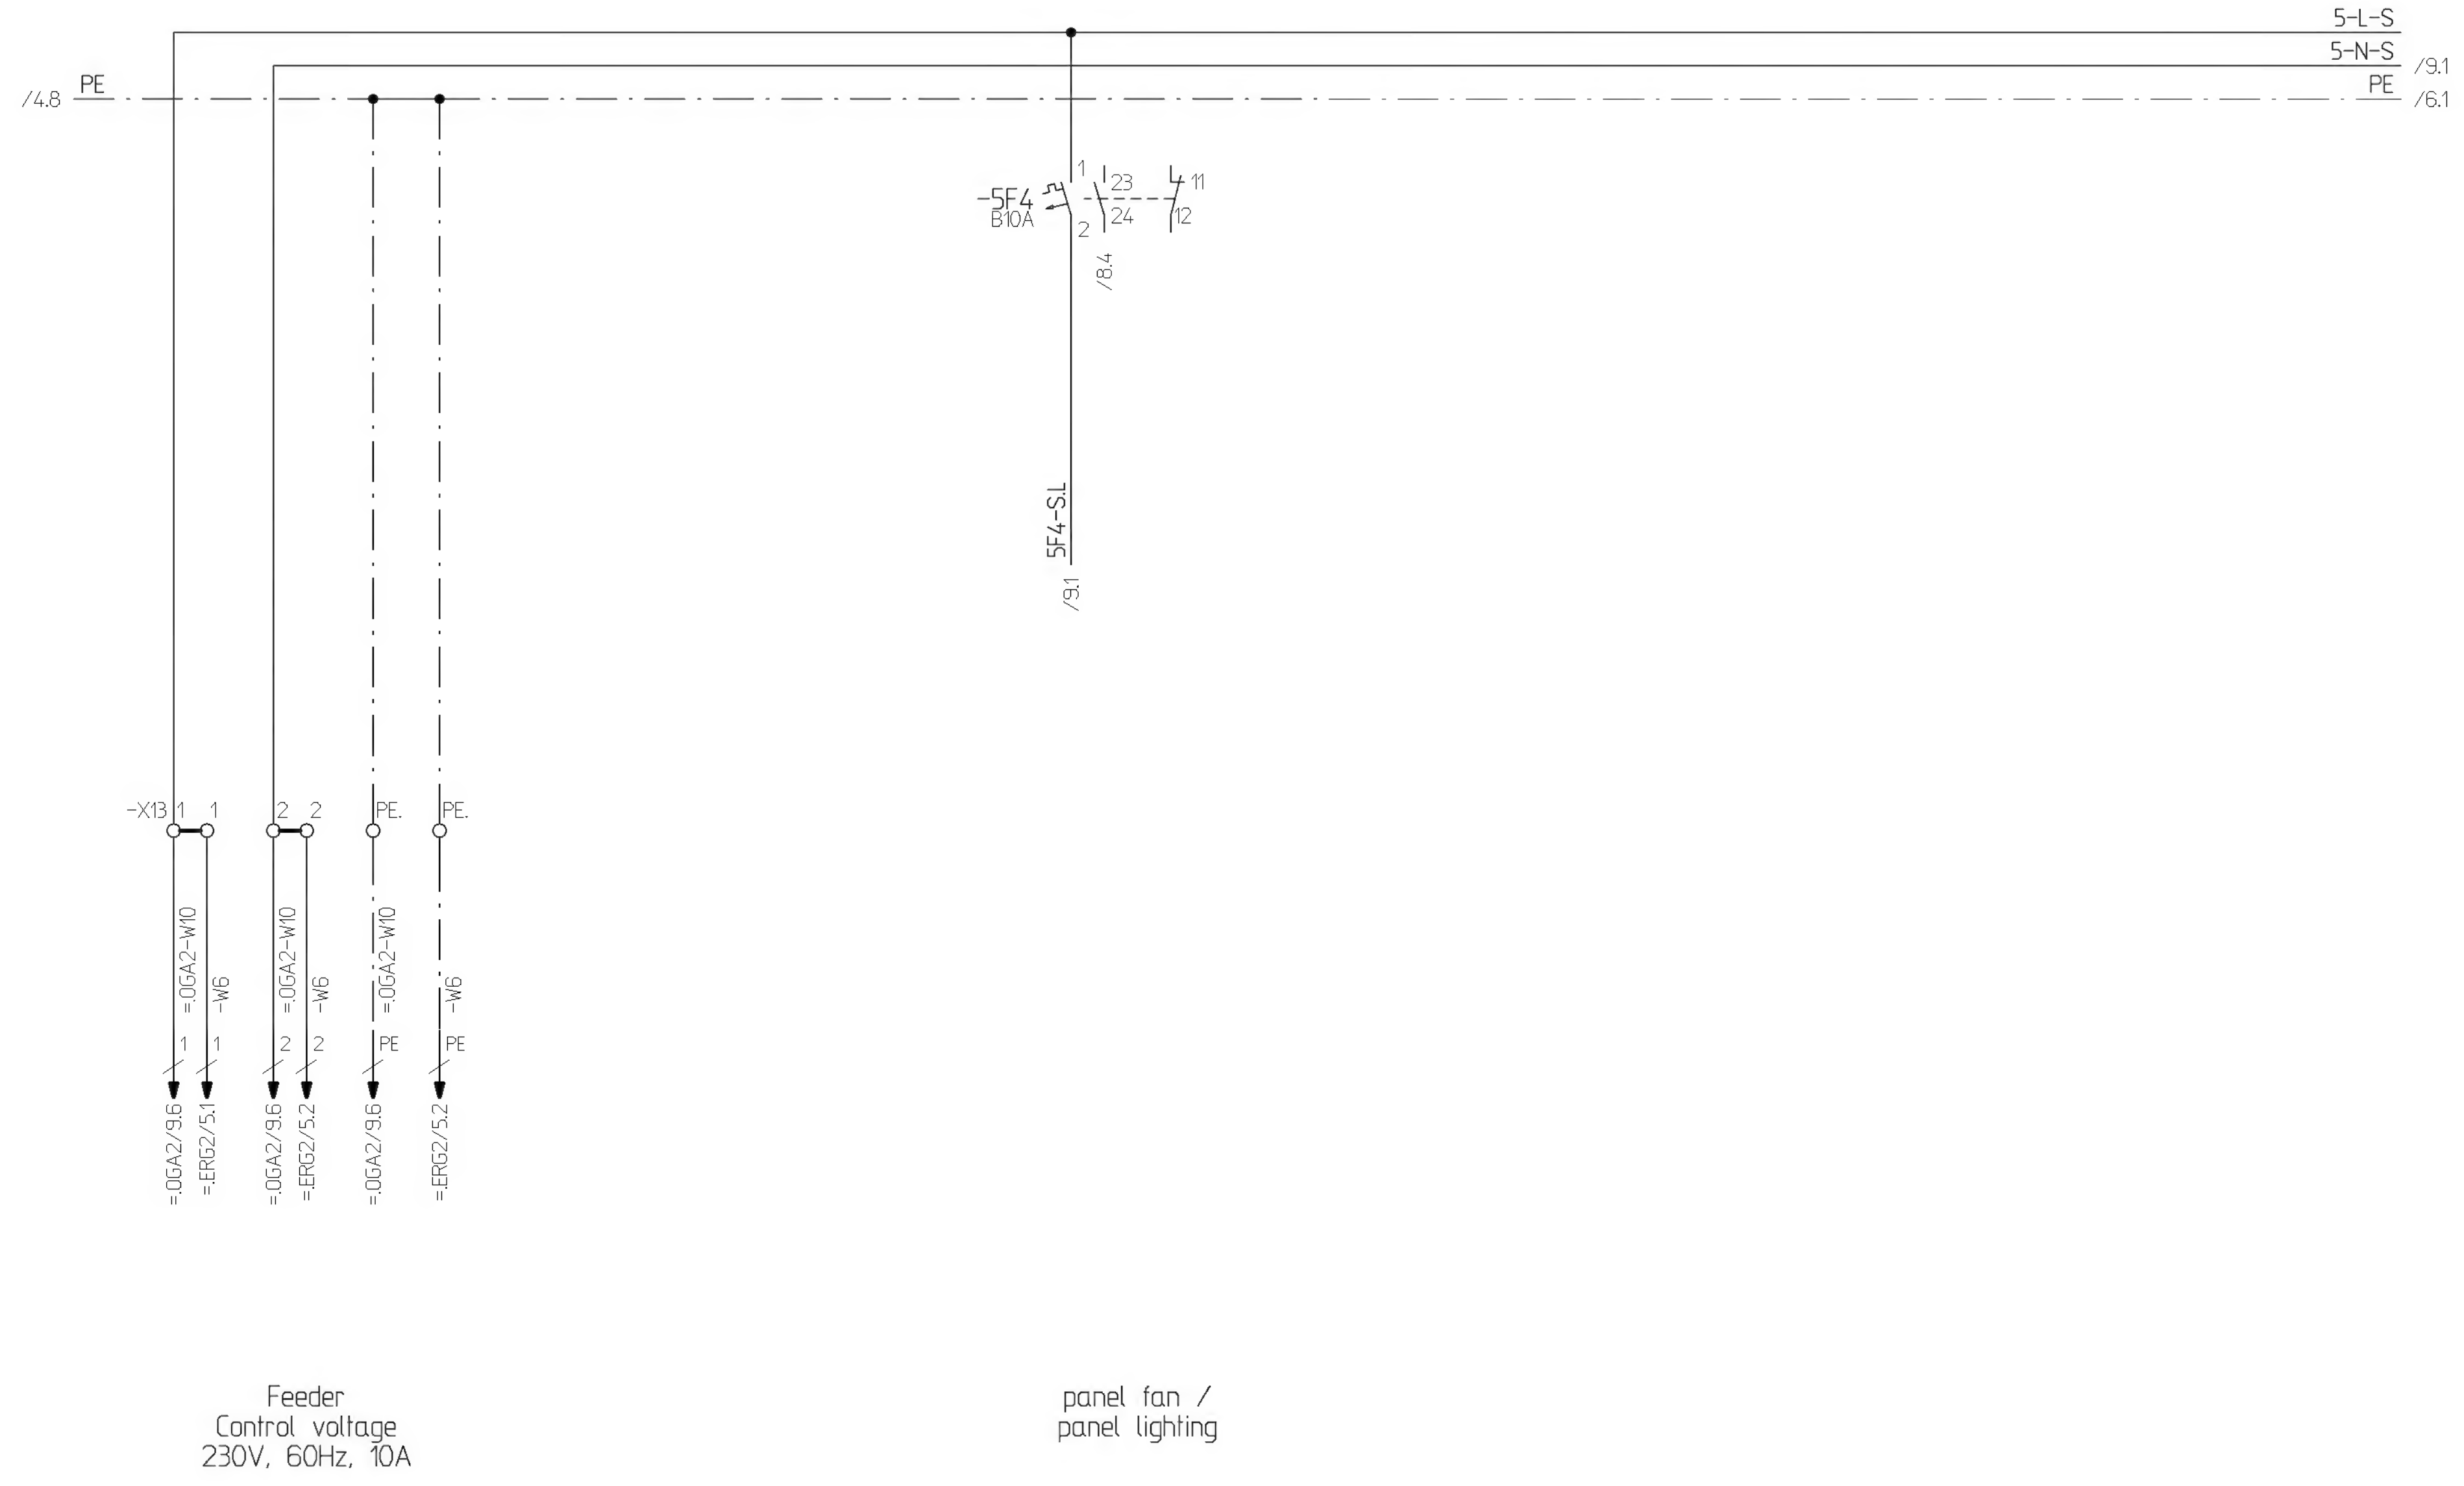

All rights reserved by KUHSE for this technical documents

Bildbeschreibung
IMAGE DESCRIPTION
consumer voltage 230V, 60Hz

				Date	08.07.03	Elektrim-MEGADEX Monde Energy Philippines	KUHSE	DPP 5(7) Syn. MST 5"/10"PC Neutr. Earthing Panel Cummins gen	4500005501	=DPP +ERG1
				Desig.	A. Stellmann					
				Check	A. Stellmann				43730	437300
Index	changing	Date	name	Norm	33	Orig. / Ers.f.	Ers.d. 11.09.03			page 5 / 9 BL

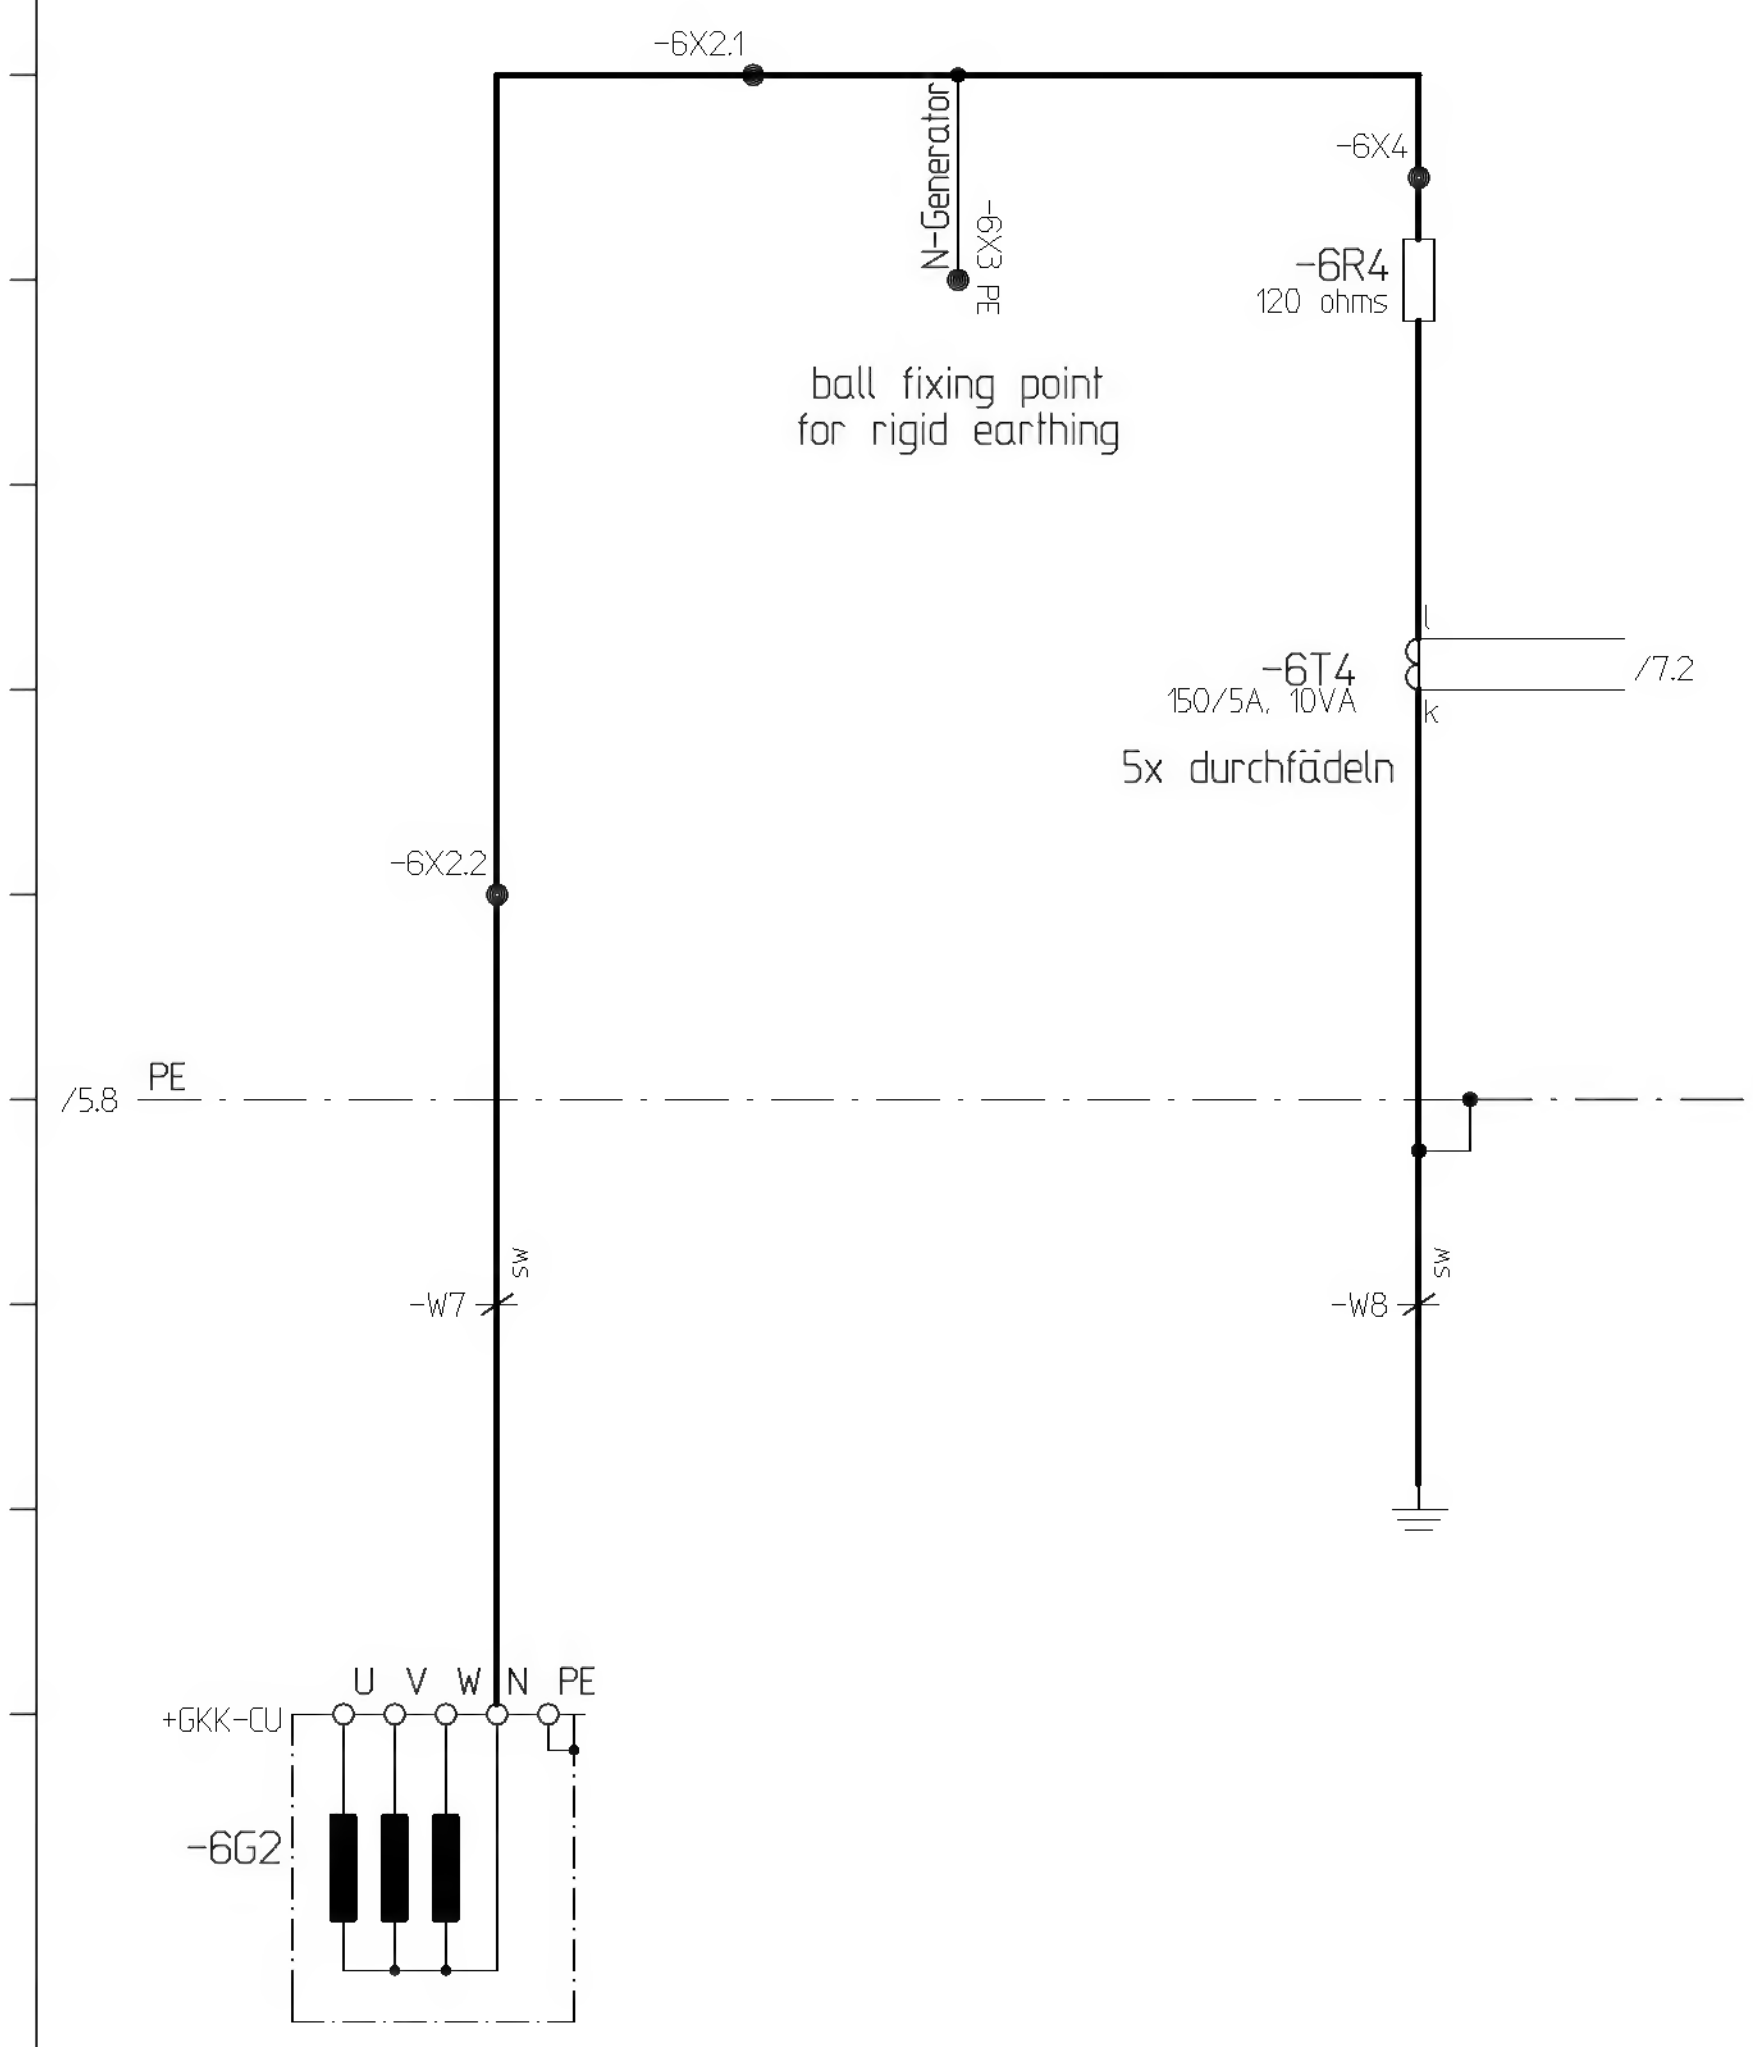

All rights reserved by KUHSE
for this technical documents

Bildbeschreibung
IMAGE DESCRIPTION

central earthing

Date	08.07.03	Elektrim-MEGADEX Monde Energy Philippines	KUHSE	DPP 5(7) Syn. MST 5"/10"PC Neutr. Earthing Panel Cummins gen	4500005501 / =DPP +ERG1
Desig.	A. Stellmann				
Check	A. Stellmann				
Norm	33	Orig. / Ers.f.	Ers.d. 11.09.03		43730 / 437300 / page 6 / 9 BL

Index | changing | Date | name

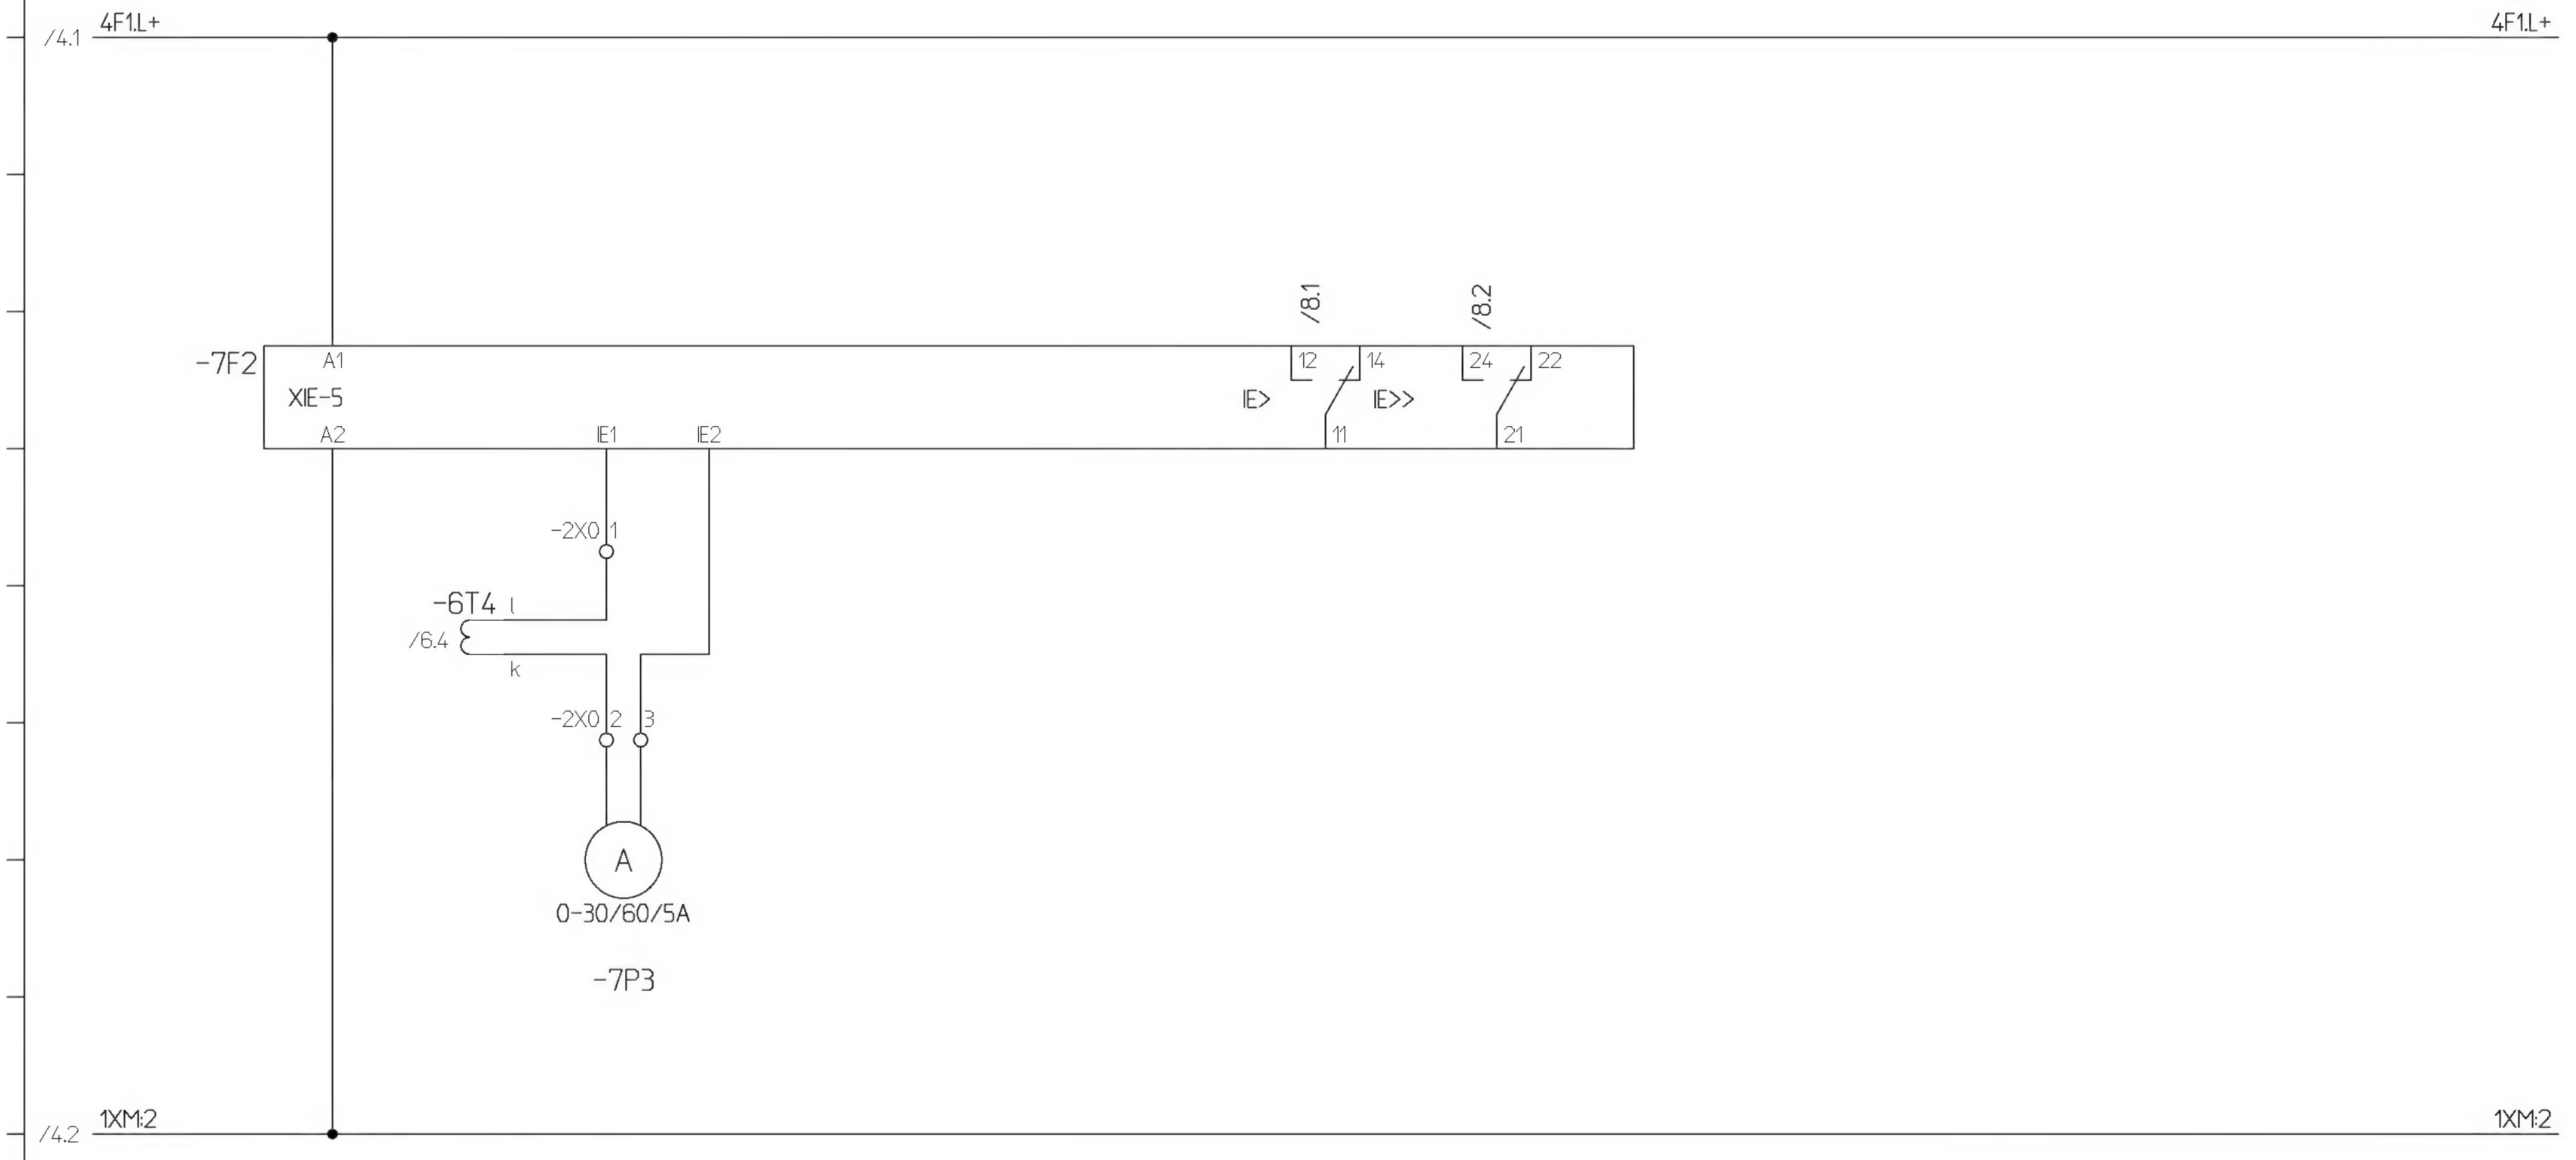

All rights reserved by KUHSE
for this technical documents

Bildbeschreibung
IMAGE DESCRIPTION

earth current monit.

				Date	08.07.03
				Desig.	A. Stellmann
				Check	A. Stellmann
Index	changing	Date	name	Norm	33

Elektrim-MEGADEX
Monde Energy Philippines

Orig. | Ers.f. | Ers.d. 11.09.03

KUHSE

DPP 5(7) Syn.
MST 5"/10"PC
Neutr. Earthing Panel Cummins gen

4500005501

43730 | 437300

=DPP
+ERG1

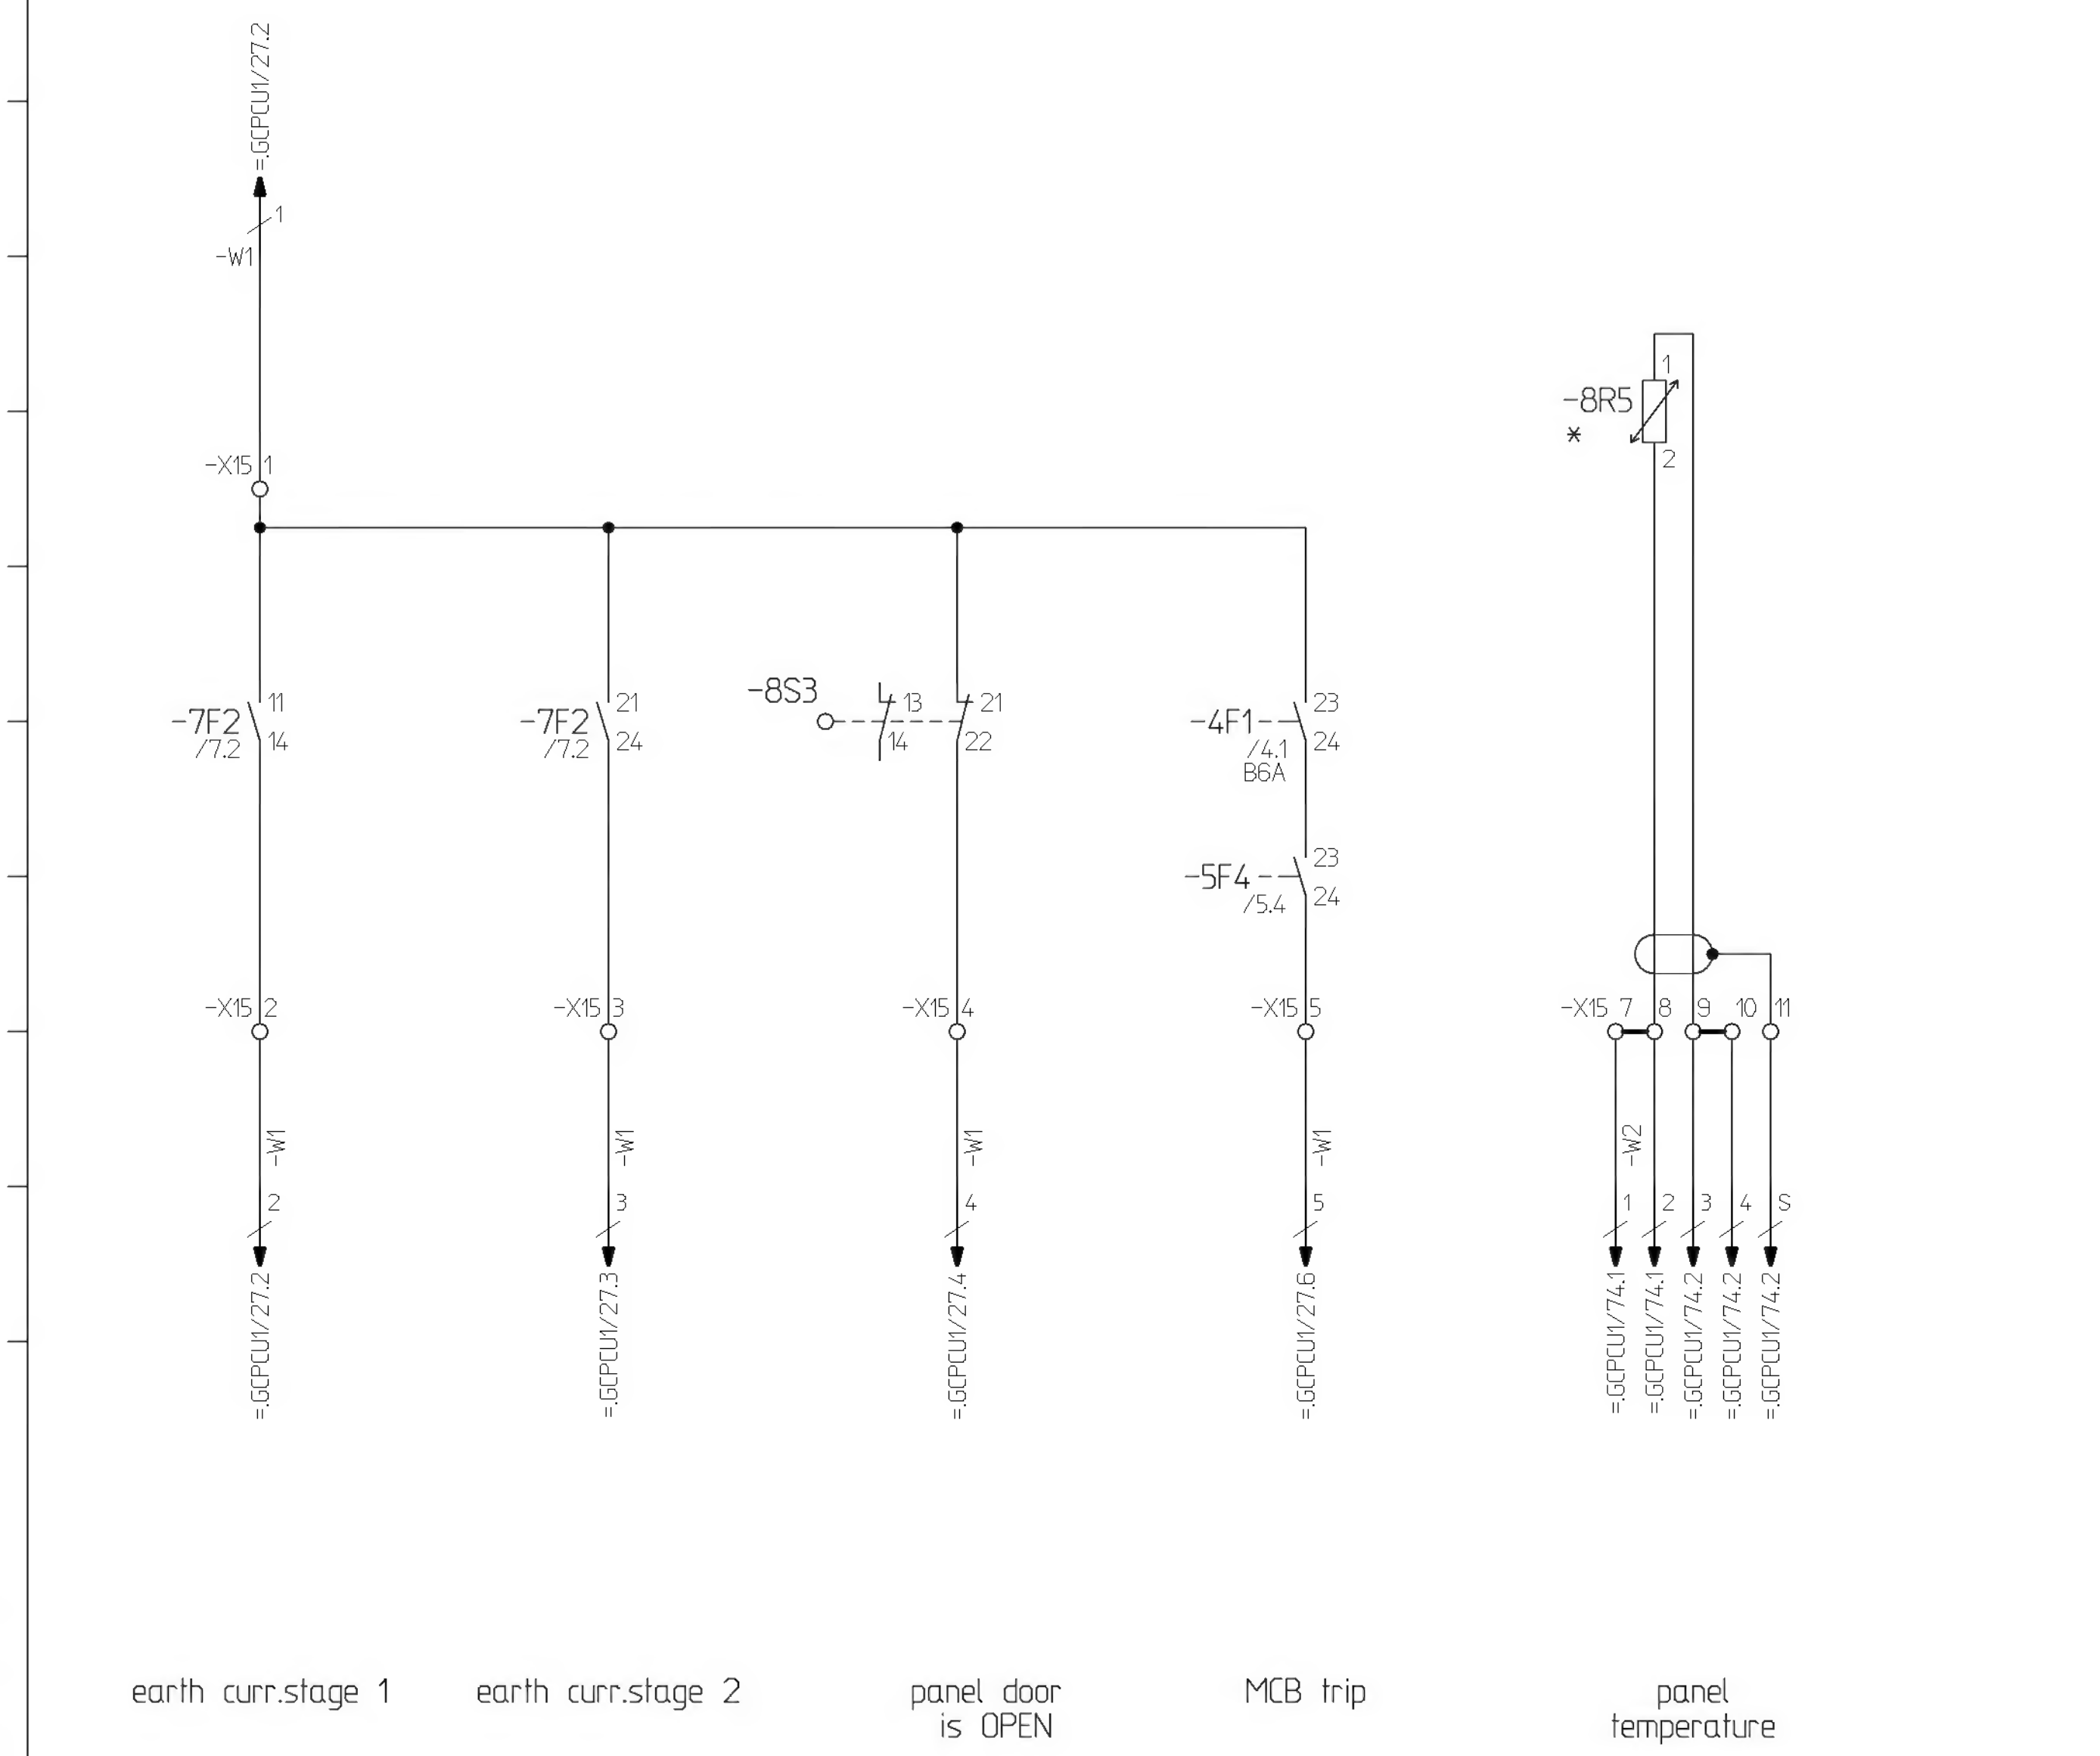

* location "above"

All rights reserved by KUHSE
for this technical documents

Bildbeschreibung
IMAGE DESCRIPTION

signals to genset control panel

			Date	08.07.03	Elektrim-MEGADEX Monde Energy Philippines	KUHSE	DPP 5(7) Syn. MST 5"/10"PC Neutr. Earthing Panel Cummins gen	4500005501	=DPP +ERG1
			Desig.	A. Stellmann					
			Check	A. Stellmann				43730 / 437300	page 8
Index	changing	Date	name	Norm	33	Orig. / Ers.f.	Ers.d. 11.09.03		9 BL

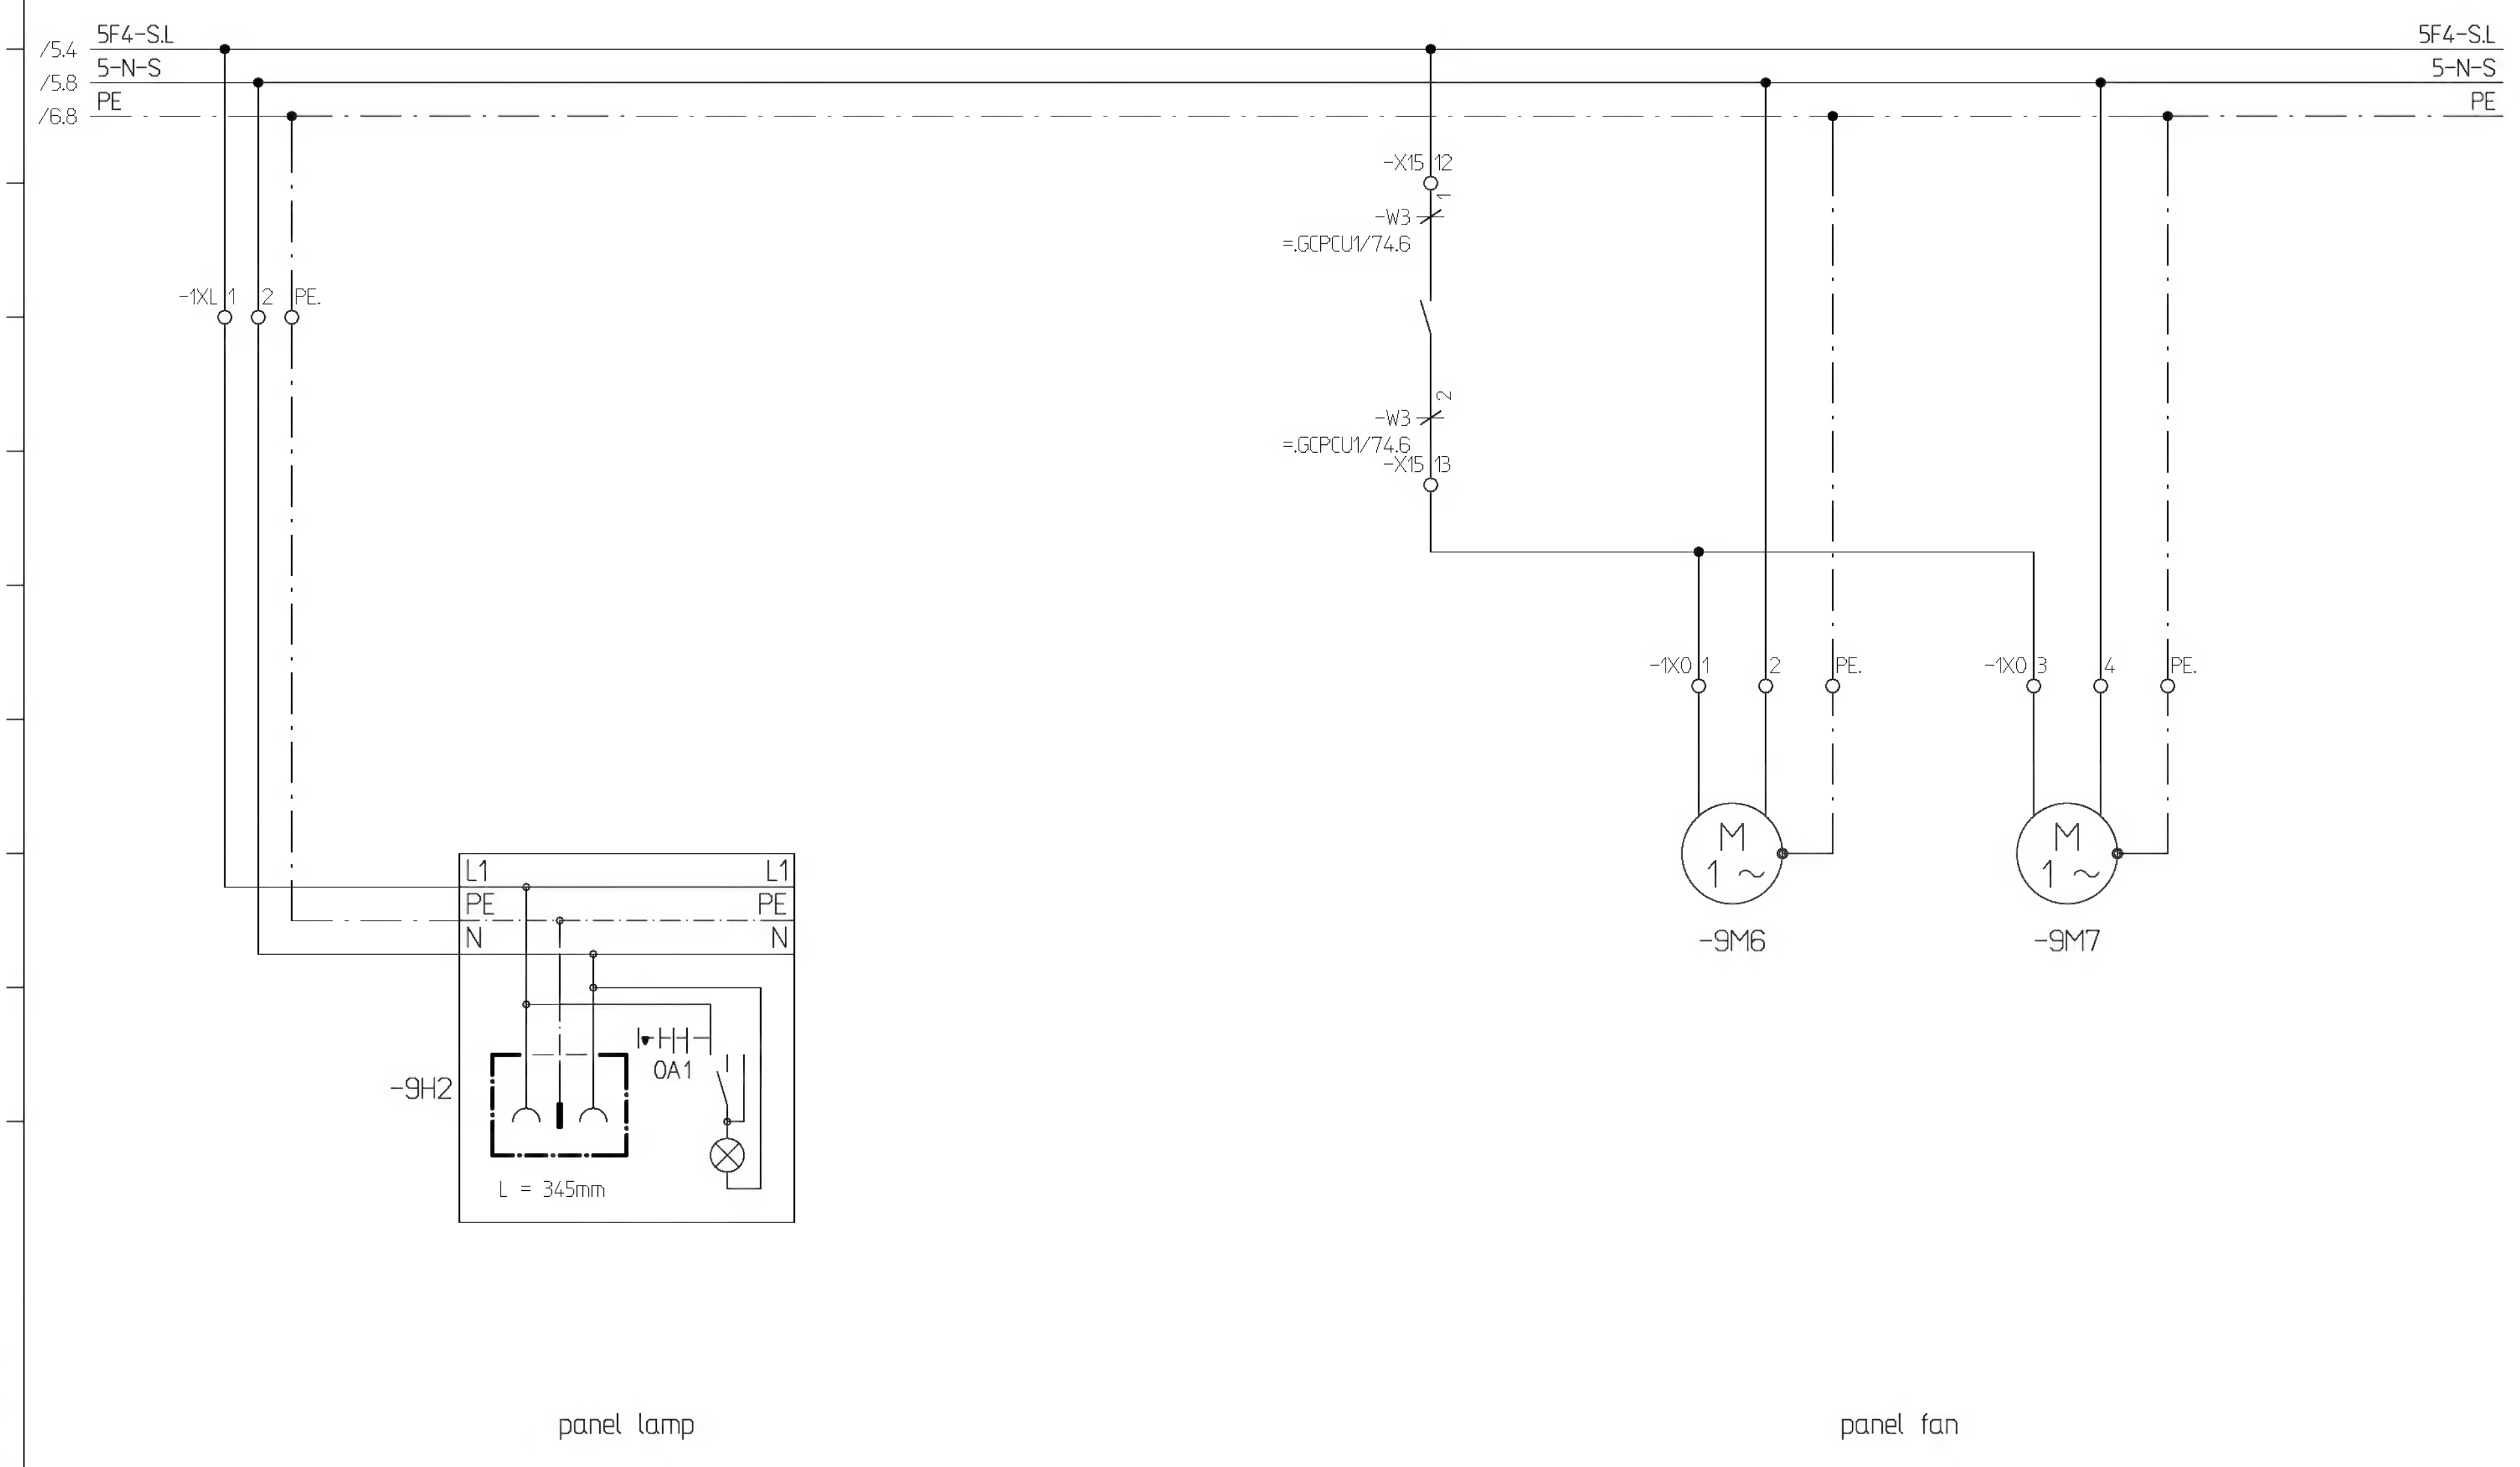

All rights reserved by KUHSE for this technical documents

Bildbeschreibung IMAGE DESCRIPTION: panel fan - /lighting

				Date	08.07.03	Elektrim-MEGADEX Monde Energy Philippines	KUHSE	DPP 5(7) Syn. MST 5"/10"PC Neutr. Earthing Panel Cummins gen	4500005501		=DPP +ERG1
				Desig.	A. Stellmann						
				Check	A. Stellmann						
Index	changing	Date	name	Norm	33	Orig. / Ers.f.	Ers.d. 11.09.03		43730	437300	page 9 / 9 BL